


VÆRKSTEDSKONTOR
må ikke fjernes

24. MAR 1983

Diagram	TEGN	HN	11/3-76
	KONST	CA EJ	14/1-76
AC.-DC. Elbox SPN			828-1957

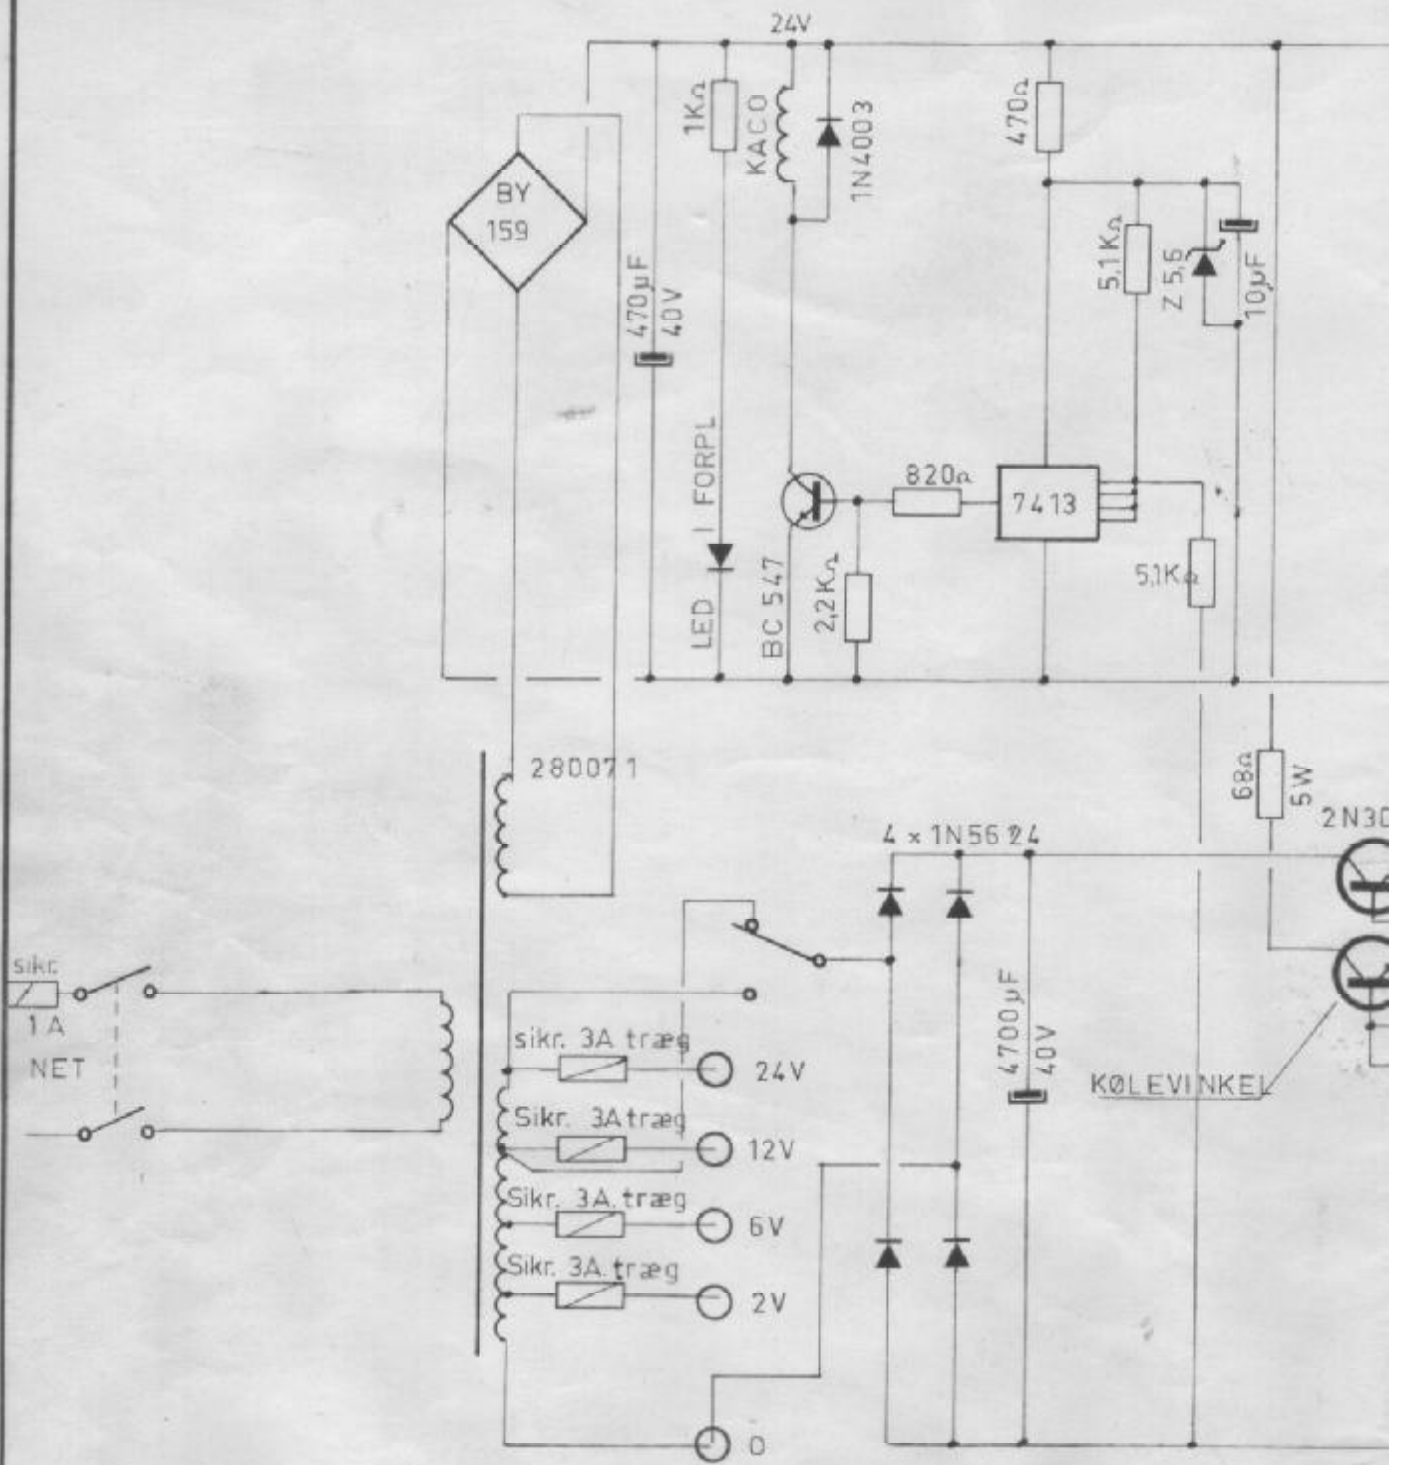

Sikr. 3A tilføjet 16/10-78 LM
 68Ω 1W til 5W 10/8-82 AB
 Sikr. 0,5A til 1A 18/3-83